

INSTALLATION

- (1) Choose a mounting location within easy reach of the sink. Make sure the Sink Mate is at least 12 inches above the chemical supply container(s).
- (2) Mount the unit using the wall anchors provided.
- (3) Connect the water supply to the swivel garden hose connection. Optimum water pressure is 30 - 40 PSI (water pressure over 40 PSI may cause splash-out on Aire-Gap equipped units). It may be possible to use a saddle-clamp to plumb directly into the water line.

IMPORTANT NOTE :
If proportioner is connected to a janitor's sink with an atmospheric vacuum breaker, a special connection kit is required by A.S.S.E. specification 1055. Failure to use this kit, or equivalent connection means, will invalidate the A.S.S.E. and I.A.P.M.O. (UPC) certification. Specify P/N 7600187 when ordering the kit.

Another possible connection is the Knight Faucet Plus Sink Adapter Kit (P/N 7114100). Contact your local Knight representative for details.

- (4) For 1 product units: Route the outgoing 3/4" vinyl tube up through the bottom of the unit and connect to the bottom of the mixing valve assembly. Flex-Gap equipped units have a "flow restrictor" inside the 3/4" tube — connect the tube so that the end with the flow restrictor is closest to the valve.

For 2 product units: A long 3/4" output hose is included so you can cut into needed lengths (many installations have one nearby sink tub, and the other is farther away). Flex-Gap equipped units have a "flow restrictor" inside both ends of the 3/4" tube. Cut the tube into the 2 lengths required for your installation, making sure that the end with the flow restrictor (if used) will be closest to the valve. Route the tubes up through the bottom of the unit and connect to the bottom of the mixing valve assemblies.

- (5) Route the discharge end of the 3/4" vinyl tube(s) to the sink, securing the tube(s) to the wall with the provided tie wraps (they have an "eyelet" for mounting hardware). Cut off any excess tube length not needed.
- (6) For 1 product units: Cut the 3/8" suction tube to a suitable length — the tube must reach from metering tip to bottom of chemical container.

For 2 product units: A long 3/8" suction tube is included with the unit. so you can cut into needed lengths. Cut the tube into the 2 lengths required for your installation — the tubes must reach from metering tips to bottom of chemical containers.

- (7) Insert the appropriate metering tip into the valve(s) — see the following page for tip selection.
- (8) Route the suction tube(s) up through the bottom of the unit and slide the tube(s) over the metering tip. Secure in place with a tie wrap.
- (9) Slide a ceramic weight onto the pickup end of the suction tube, then insert a footvalve into the tube.
- (10) Drop the suction tube(s) into the chemical container(s), ensuring that the ceramic weight pulls the footvalve(s) down to the bottom of the container(s).

OPERATION

Turn the "T" handle (on the ball valve) counter-clockwise to open the valve, and clockwise to close it. Check all connections for leaks and verify that chemical is being pulled up suction line. Make any necessary adjustments and the unit is then ready to go!


METERING TIP SELECTION

The chart below is based upon the chemical viscosity of water (CPS = 1.0) and should only be used as a guide. Actual ratios and flow rates may vary due to product viscosity, flow pressure, and tubing distance. To easily calculate the actual ounces per gallon for a specific product:

- (1) Fill graduated cylinder or spray bottle (that has ounce markings) with product.
- (2) Install metering tip closest to desired ounces per gallon from chart.
- (3) Drop chemical pick-up tube into the container holding the product.
- (4) Activate valve until chemical line is primed up to the metering tip.
- (5) Note how many ounces of product are in the container.
- (6) Activate valve again, filling a one gallon jug with water/product mix.
- (7) Note how many ounces of product were used — this is your actual ounce per gallon ratio.

TIP COLOR	AIRE-GAP (3 GPM)		FLEX-GAP (4 GPM)	
	OZ/GAL	RATIO	OZ/GAL	RATIO
NO INSERT	21	5.1:1	25	4.3:1
WHITE	20	5.4:1	20	5.4:1
YELLOW	18	6.1:1	18	6.1:1
PINK	16	7.0:1	16	7.0:1
GREEN	12	10:1	12	12:1
BLACK	10	12:1	10	15:1
BROWN	7	17:1	7	20:1
GRAY	5	25:1	5	31:1
BLUE	4	31:1	4	42:1
RED	3	42:1	3	63:1
PEACH	2	63:1	2	72:1
LT BLUE	1.5	84:1	1.5	101:1
PURPLE	1	127:1	1	127:1
LT GREEN	0.75	170:1	0.75	170:1
ORANGE	0.50	255:1	0.50	255:1
LT BROWN	0.25	511:1	0.25	511:1

SINK MATE ASSEMBLY DIAGRAM

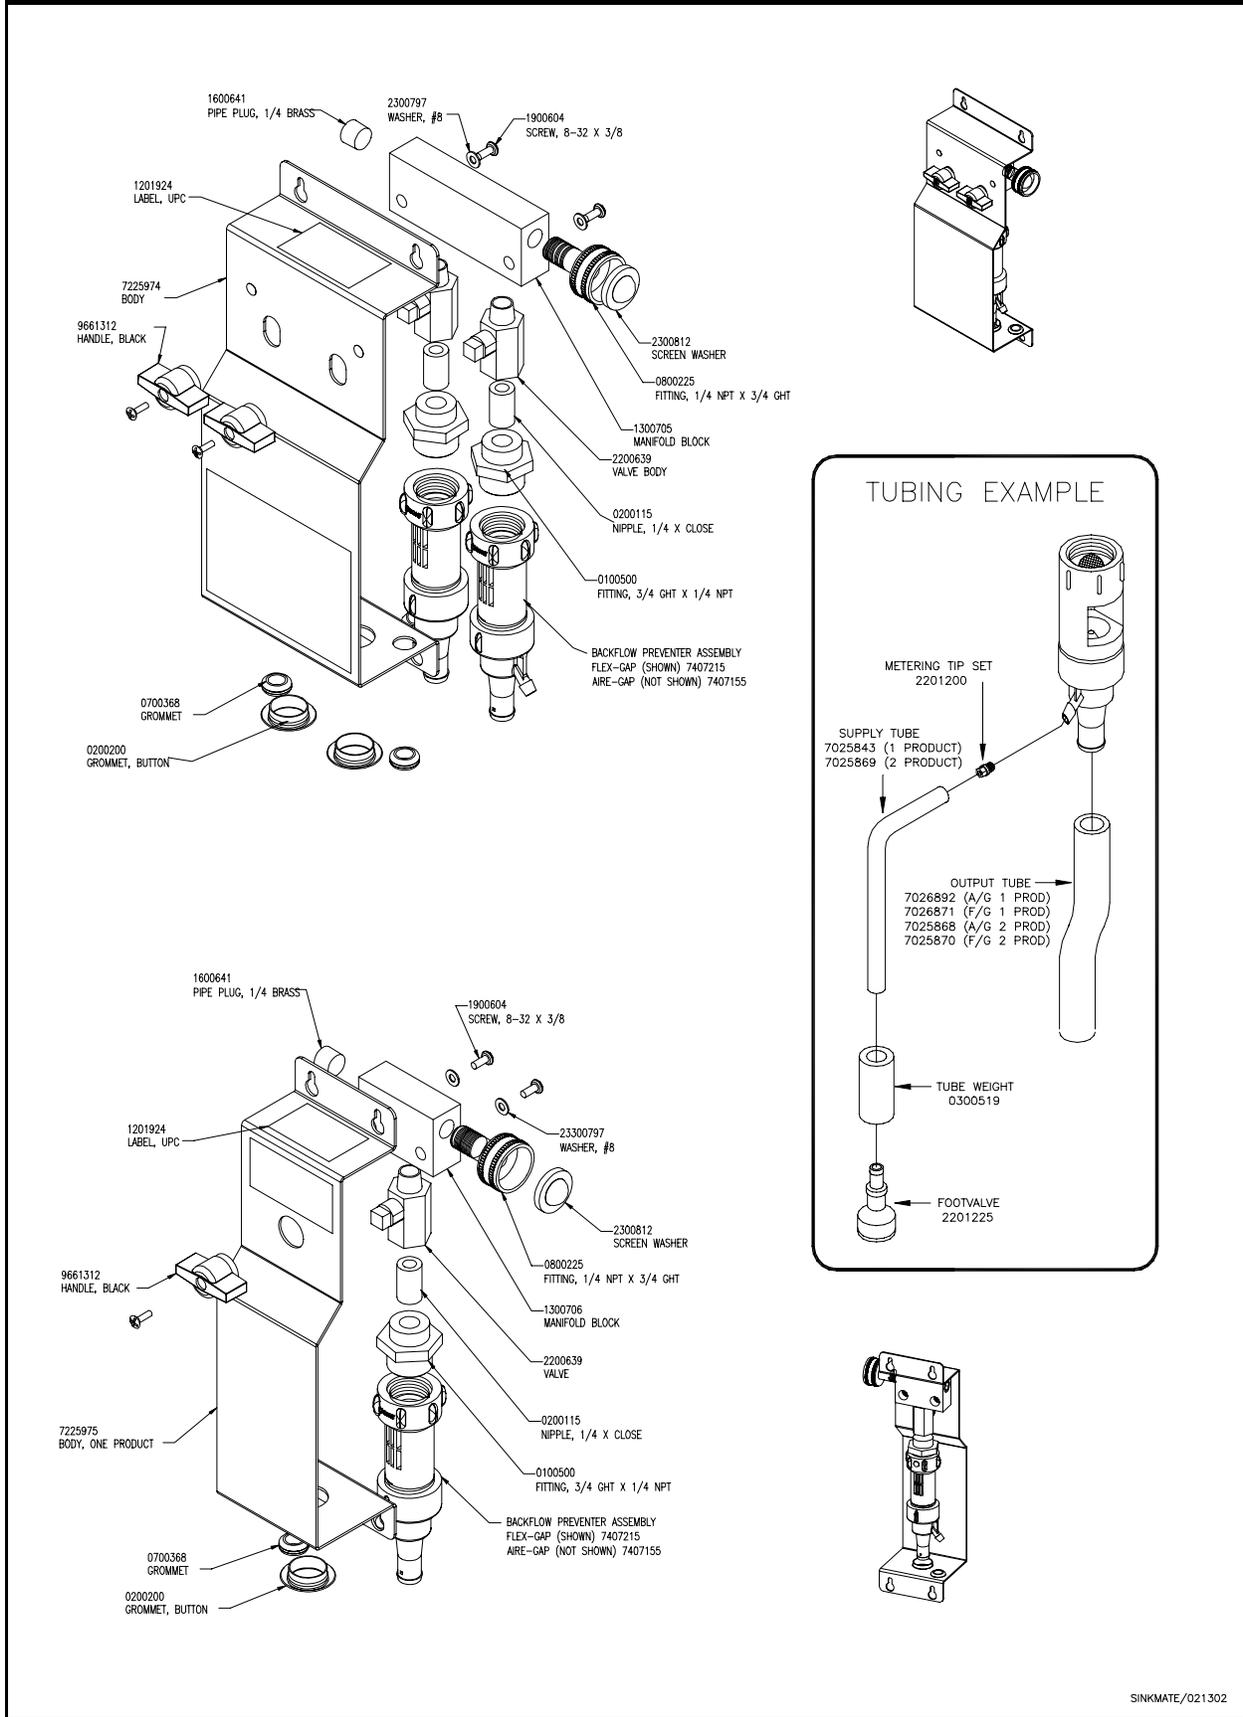

SINKMATE/021302

DISCLAIMER

Knight Inc. does not accept responsibility for the mishandling, misuse, or non-performance of the described items when used for purposes other than those specified in the instructions. For hazardous materials information consult label, MSDS, or Knight Inc.

WARRANTY

All Knight controls and pump systems are warranted against defects in material and workmanship for a period of ONE year. All electronic control boards have a TWO year warranty. Warranty applies only to the replacement or repair of such parts when returned to factory with a Knight Return Authorization (KRA) number, freight prepaid, and found to be defective upon factory authorized inspection. Bearings and pump seals or rubber and synthetic rubber parts such as "O" rings, diaphragms, squeeze tubing, and gaskets are considered expendable and are not covered under warranty. Warranty does not cover liability resulting from performance of this equipment nor the labor to replace this equipment. Product abuse or misuse voids warranty.

KNIGHT INC. A Unit of IDEX Corporation

World Headquarters: 20531 Crescent Bay Drive, Lake Forest, CA 92630-8825 (USA) TEL: 949-595-4800, FAX: 949-595-4801, www.knightequip.com

Atlanta Branch:
8111 Technology Dr. NE
Covington, GA
30014 USA
TEL: 770-787-9400
FAX: 770-787-1155

Toronto Branch:
2880 Argentia Road, Unit 6
Mississauga, Ontario
LSN 7X8 Canada
TEL: 905-542-2333
FAX: 905-542-1536

London Branch:
#15 Brunel Centre
Newton Road, Crawley
West Sussex UK RH10 9TU
TEL: 44-1293-615570
FAX: 44-1293-615585

Sydney Branch:
Unit 28, 317-321
Woodpark Rd., Smithfield
NSW Australia 2164
TEL: 61-29-725-2588
FAX: 61-29-725-2025

Amsterdam Branch:
Marssteden 68
7547 TD Enschede
The Netherlands
TEL: 31-53-428-58-00
FAX: 31-53-428-58-09

Spain Branch:
Port Ginesta, Local 210
08860 Sitges
Barcelona Spain
TEL: 34-936-342-130
FAX: 34-936-643-477